


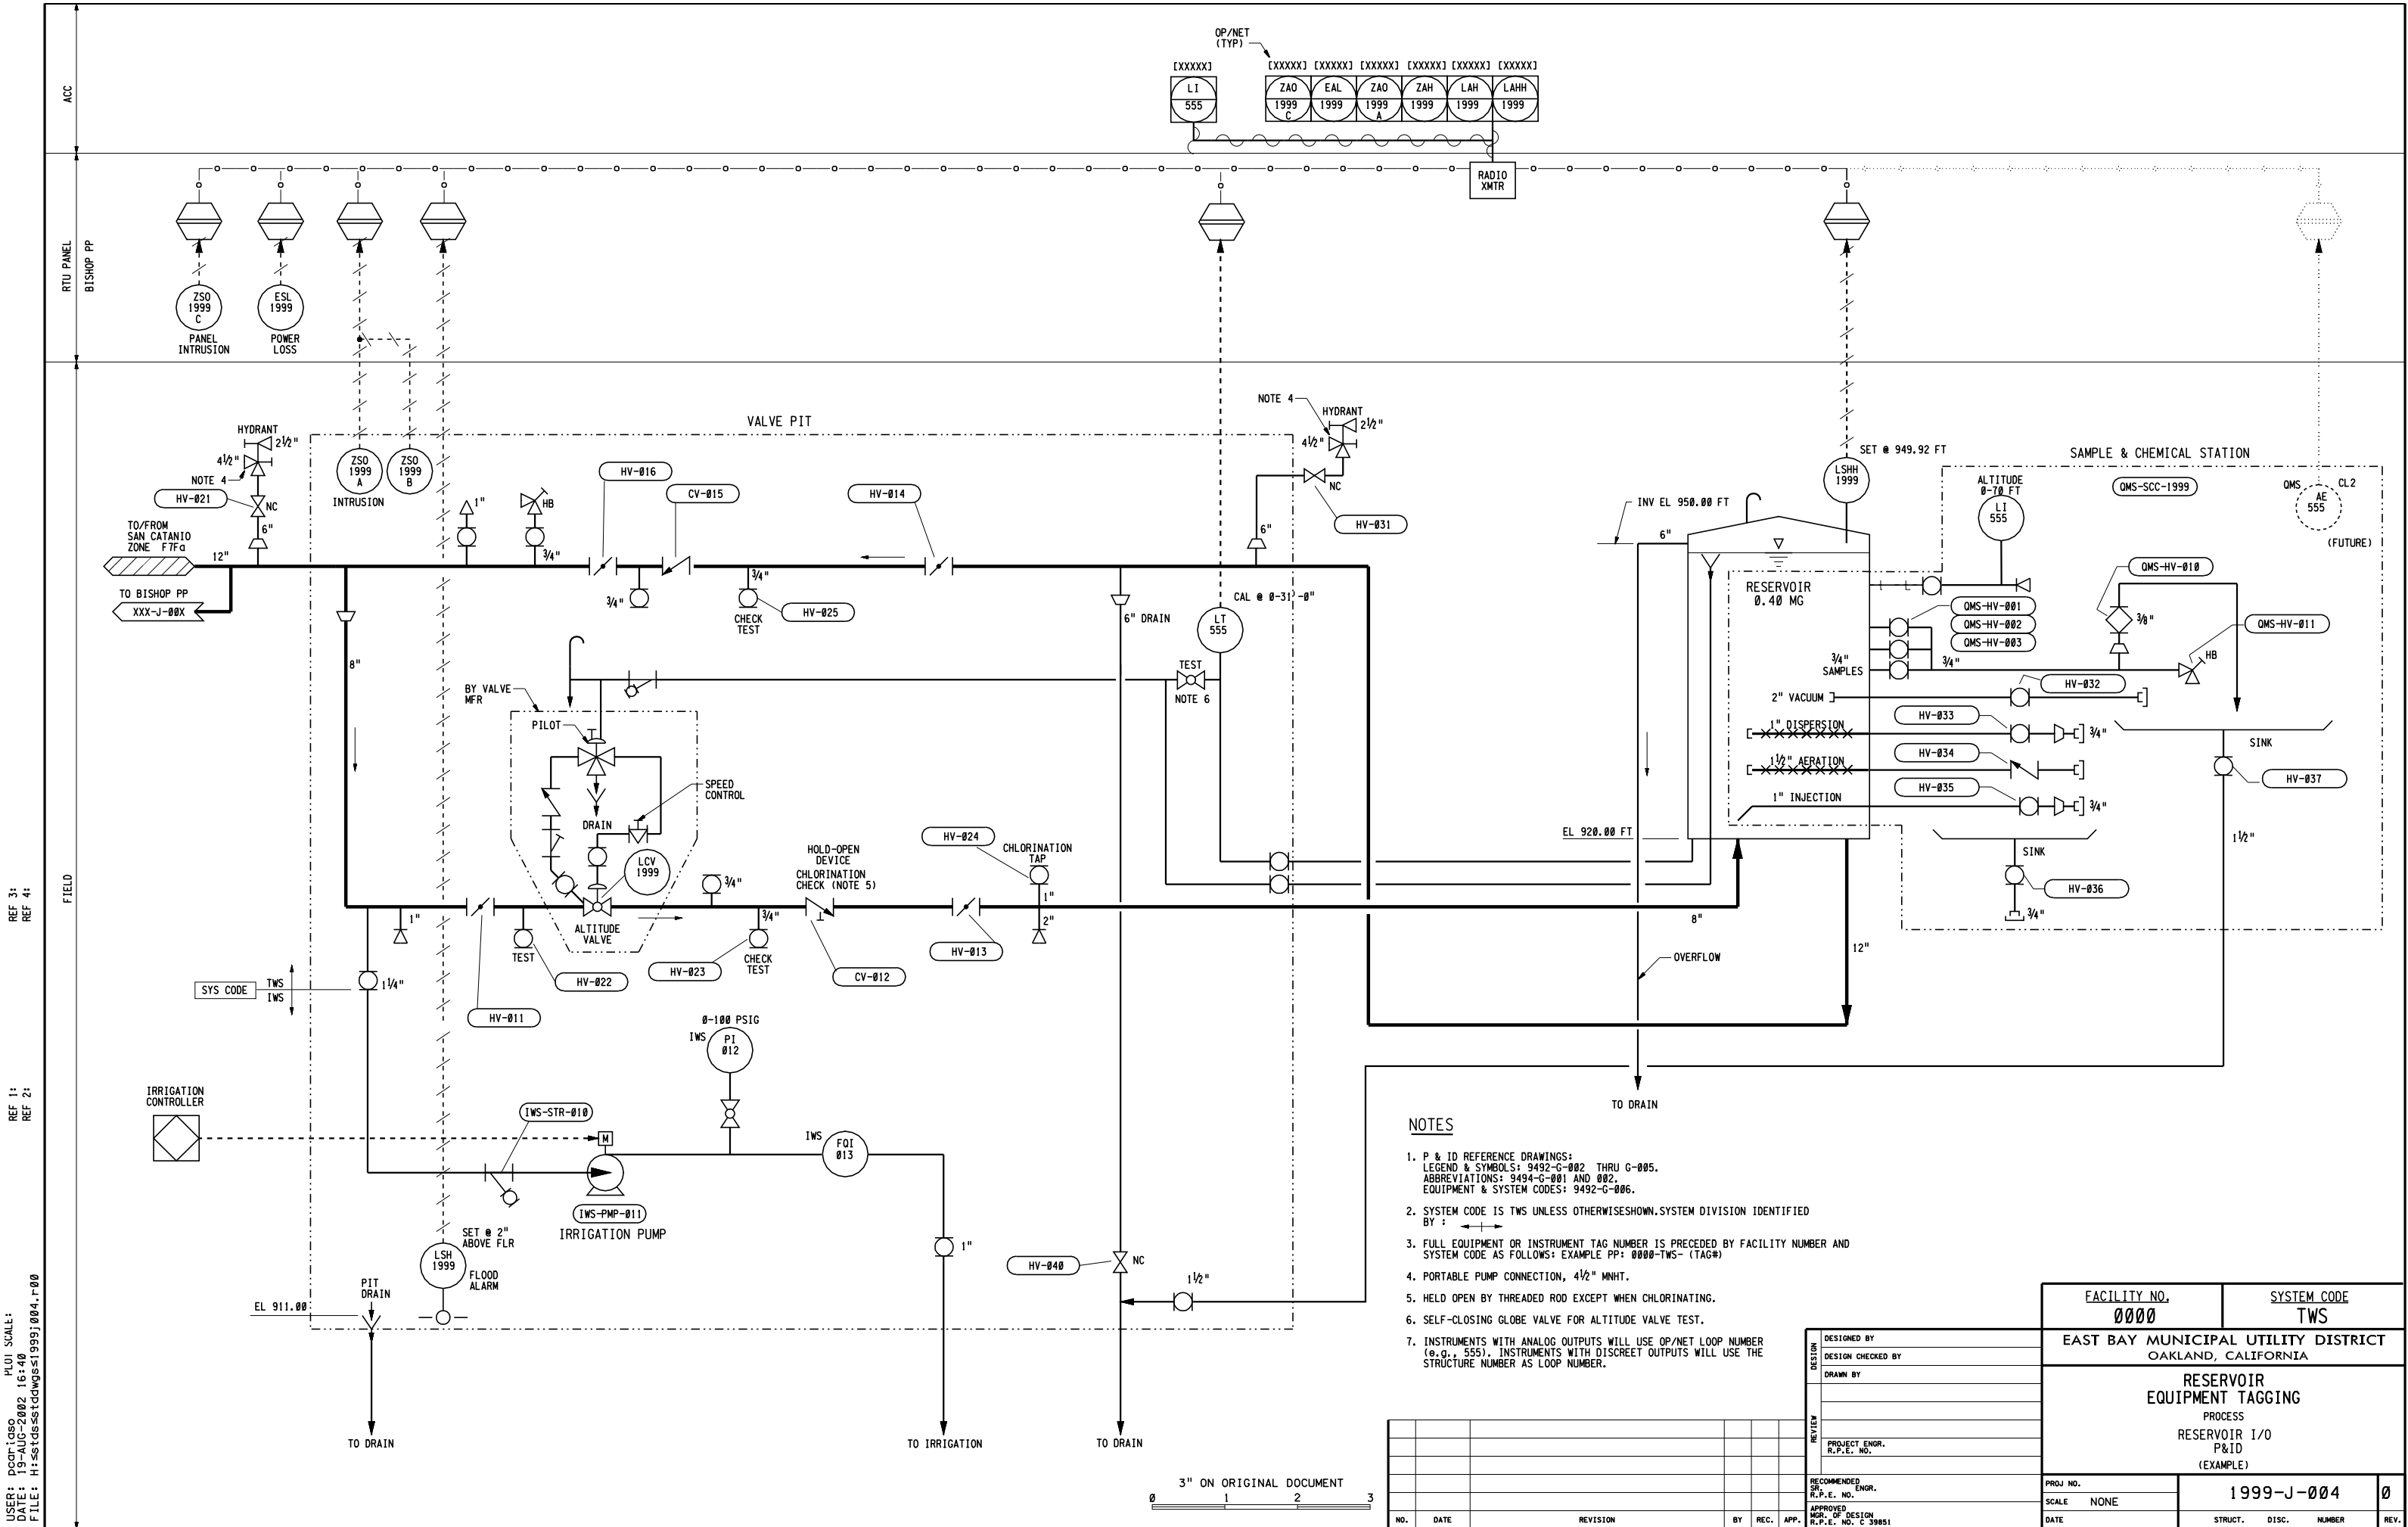

NOTES

1. P & ID REFERENCE DRAWINGS:
LEGEND & SYMBOLS: 9492-G-002 THRU G-005.
ABBREVIATIONS: 9494-G-001 AND 002.
EQUIPMENT & SYSTEM CODES: 9492-G-006.
2. SYSTEM CODE IS TWS UNLESS OTHERWISE SHOWN. SYSTEM DIVISION IDENTIFIED BY : $\longleftrightarrow$
3. FULL EQUIPMENT OR INSTRUMENT TAG NUMBER IS PRECEDED BY FACILITY NUMBER AND SYSTEM CODE AS FOLLOWS: EXAMPLE PP: 0000-TWS- (TAG#)
4. PORTABLE PUMP CONNECTION, 4 1/2" MNHT.
5. HELD OPEN BY THREADED ROD EXCEPT WHEN CHLORINATING.
6. SELF-CLOSING GLOBE VALVE FOR ALTITUDE VALVE TEST.
7. INSTRUMENTS WITH ANALOG OUTPUTS WILL USE OP/NET LOOP NUMBER (e.g., 555). INSTRUMENTS WITH DISCREET OUTPUTS WILL USE THE STRUCTURE NUMBER AS LOOP NUMBER.

NO.	DATE	REVISION	BY	REC.	APP.

DESIGNED BY	
DESIGN CHECKED BY	
DRAWN BY	
PROJECT ENGR.	
R.P.E. NO.	
RECOMMENDED	
S.R.P.E. NO.	
APPROVED	
MOR. OF DESIGN	
R.P.E. NO. C 39851	

FACILITY NO. 0000	SYSTEM CODE TWS
EAST BAY MUNICIPAL UTILITY DISTRICT OAKLAND, CALIFORNIA	
RESERVOIR EQUIPMENT TAGGING PROCESS RESERVOIR I/O P&ID (EXAMPLE)	
PROJ. NO.	1999-J-004
SCALE NONE	0
DATE	STRUCT. DISC. NUMBER REV.